## GENERAL NOTES

- 1. PROVIDE EROSION PROTECTION IF REQ'D BY GOVERNING AUTHORITIES.
- 2. PROVIDE P.T. WD. WHERE IN CONTACT W/ EPOM ROOFING, FLASHING WATERPROOFING, MASONARY, CONCRETE OR EARTH.
- 3. ALL WOOD FASTENERS, HANGERS, ETC. IN CONTACT w/. P.T. WD. TO RECEIVE MIN. G90 GALV OR GREATER AS REQD. BY FASTENER MFR. FOR TYPE OF P.T. CHEMICAL USED AND/OR ENVIROMENT.
- 4. CONFORM TO ELECRIC REQTS. OF NEC 2002 INCL. GFIC RECEPTS. & GROUNDING OF CONC. SLABS ANIMAL USE AREAS.
- 5. FRAMING POSTS & STUDS ? SPF STUDS ? O.C.
- 6. CONC. FOOTERS ARE SIZED ASSUMING A MIN. SOIL BEARING CAPACITY OF 3000 PSF
- 7. CONCRETE SLAB TO BE MIN. 4" THICK WITH WIRE-MESH
- 8. TOTAL AREA UNDER ROOF (INCLUDES OVERHANGS) ??? SQ.F.

DO NOT SCALE DIMENSIONS OFF DRAWINGS. USE WRITTEN OR CALCULATED ALL CONTRACTORS ARE RESPONSIBLE FOR CHECKING DIMENSIONS BEFORE ESTIMATING, ORDERING OR STARTING WORK.

ALL WORK SHALL CONFORM TO CODES AND REQUIREMENTS OF LOCAL, COUNTY, STATE, NATIONAL BUILDING SAFETY CODES AND OTHER AGENCIES AND AUTHORITIES HAVING JURISDICTION OVER THE PROJECT.

## CODE INFO. ON STRUCTURE:

CONSTRUCTION TO CONFORM WITH DESIGN DOCUMENTS & ALL CODE REQTS.

1. FOUNDATIONS DESIGNED FOR ASSUMED ALLOWABLE NETSOIL BEARING PRESSURE OF 3000 PSF

- 2. DESIGN LIVE LOADINGS AS FOLLOWS: - SNOW: 45 PSF GROUND SNOW LOAD
- WIND: 110 MPH (EXPOSURE C) - SEISMIC USE GROUP: 1 - SEISMIC FORCE RESIST: WD. FRAME
- 3. DEAD LOADS AS FOLLOWS: - TRUSSES w/. SHINGLES - ? PSF - WOOD FLOORING - ? PSF

- WEATHERING: SEVERE


- 4. PLACE FILL & BACKFILL IN MAX. 8" LIFTS. COMPACT EACH LAYER UNDER FOOTINGS & SLABS TO A DRY DENSITY OF MIN. 95%. DO NOT BUILD ON SOILS LESS THAN INDICATED DESIGN STRENGTH.
- 5. CONCRETE TO HAVE 28-DAY MIN. COMPRESSIVE STRENGTH AS FOLLOWS:
- CONCRETE TO HAVE 28-DAY MIN. COMPRESSIVE STRENC
   4000 PSI AT EXT. SLABS
   3000 PSI ALL OTHER LOCATIONS
   PROVIDE COVERING OF REINF. PER IBC TABLE 1907.7.1
   PROVIDE CORNER BARS TO MATCH CONTIN. REIFN.
   LAP ALL REINF. MIN 24" W.W.F. TO LAP MIN. 8".
- 6. SLABS ON GRADE TO HAVE CONTROL JTS. SO AREA IS LESS THAN 625 S.F. WITH PATIO OF LENGTH-WIDTH OF AREA LESS THAN 15.

7. ALL STRUCTURAL WOOD TO BE GRADED LUMBER - MIN. S.P.F. OR #2 HEM-FIR UNLESS NOTED OTHEWISE.

8. CONTRACTOR IS RESPONSIBLE OF MEANS OF CONSTRUCTION, INCL. PROVIDNG GUYS, BRACING & SHORING AS REQUIRED FOR ALL LOADING CONDITIONS THROUGHTOUT CONSTRUCTION. CONTRACTOR IS NOT TO STORE MATERIALS IN EXCESS OF DESIGN LIVE LOADS WITHOUT APPROVAL OF ARCH.

9. ALL STAIRS & RAILING TO CONFORM w/. LOADING REQTS. IN CODE

## SYMBOL LEGEND

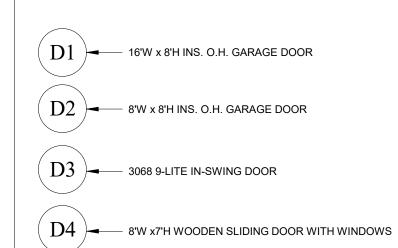

 $\langle \mathrm{W1} 
angle$  36"x48" SINGLE HUNG VINYL INS. WINDOW

 $\langle W2 
angle$  30"x30" SINGLE HUNG VINYL INS. WINDOW

1 DETAIL NUMBER A.1 — SHEET DETAIL IS LOCATED




SECTION NUMBER - SHEET SECTION IS LOCATED


BEFORE USING THIS PLAN:

1. YOU MUST FIRST CONFIRM THIS PLAN FOR CODE COMPLIANCE WITH AN ENGINEER OR YOUR LOCAL CODE OFFICIAL.

2. THIS PLAN IS NOT DESIGNED FOR HIGH WIND ZONES AND WILL NEED TO BE MODIFIED BY AN ENGINEER OR AN ARCHITECT TO COMPLY WITH HIGH WIND

3. IF THIS PLAN IS USED AS-IS WITHOUT FIRST CONFIRMING WITH AN ENGINEER, END USER SHALL BE FULLY RESPONSIBLE FOR ANY OR ALL CONSEQUENCES THAT MIGHT ARISE OUT OF USE OF THIS PLAN.

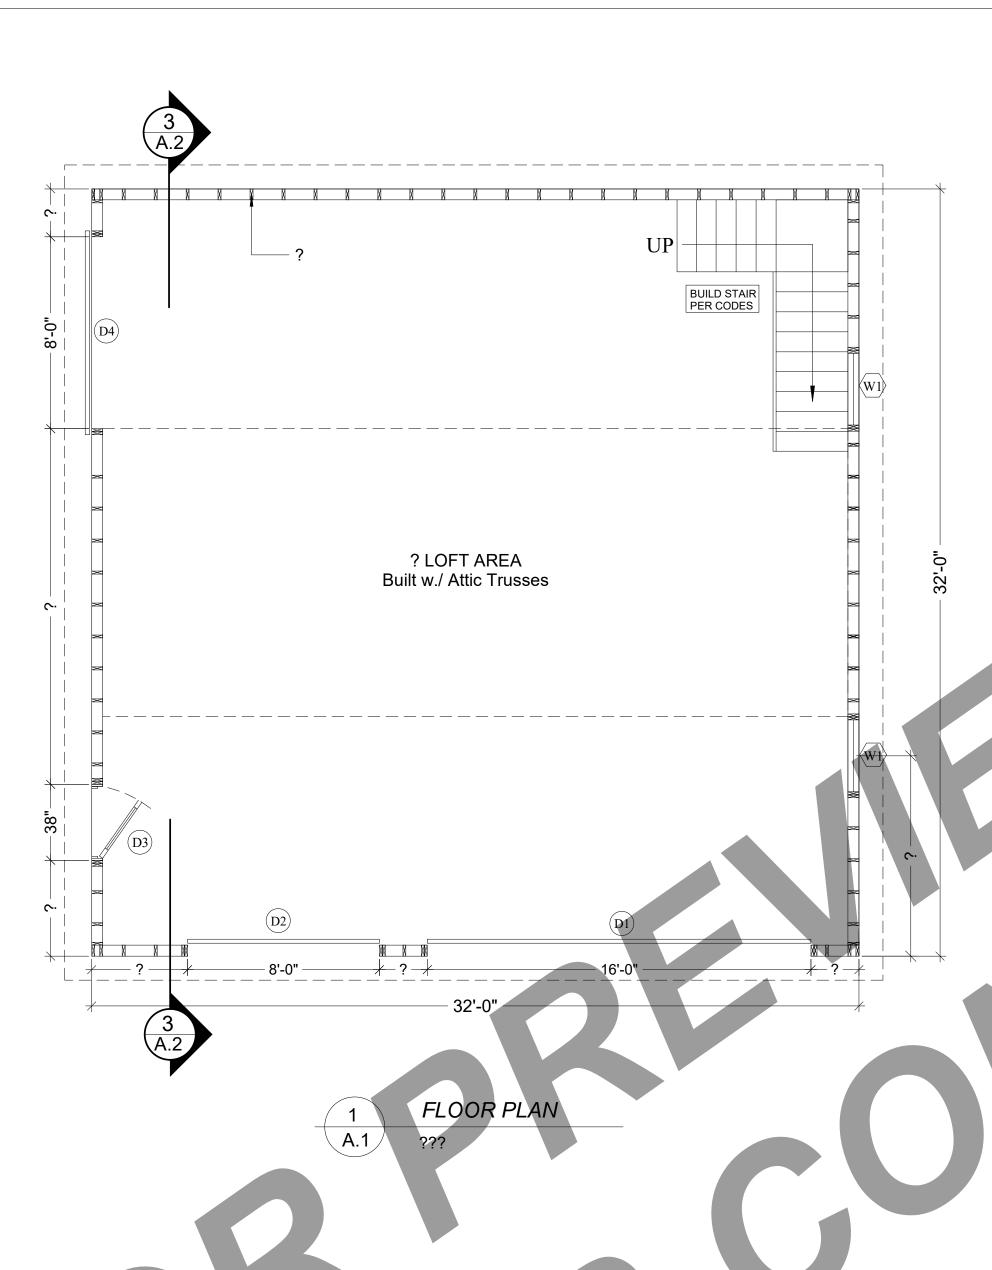


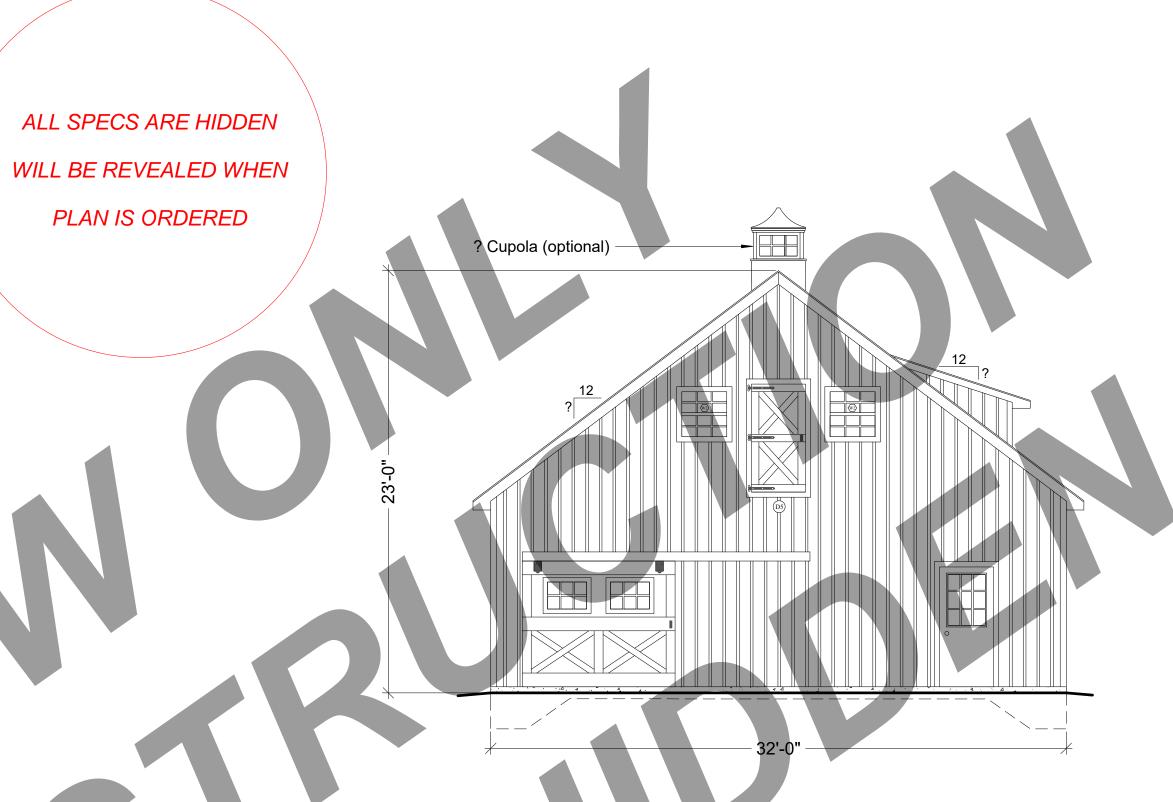


PLAN IS ORDERED

FRONT ELEVATION

LEFT SIDE ELEVATION

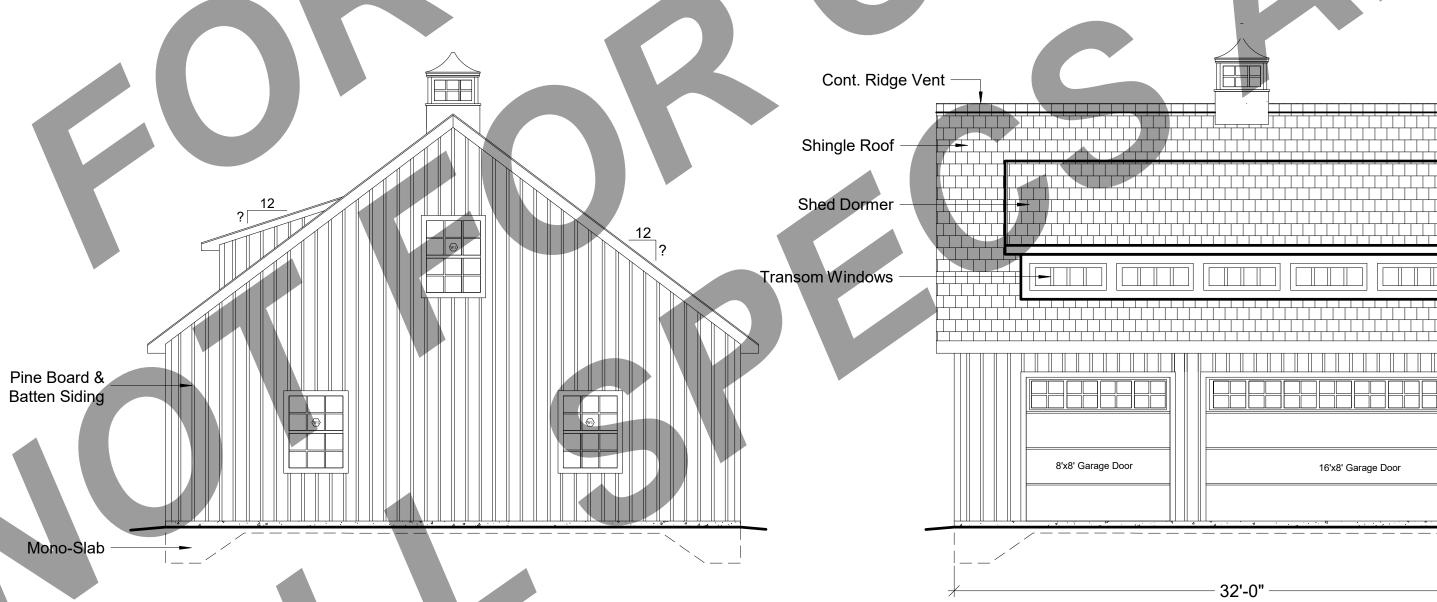

RIGHT SIDE ELEVATION

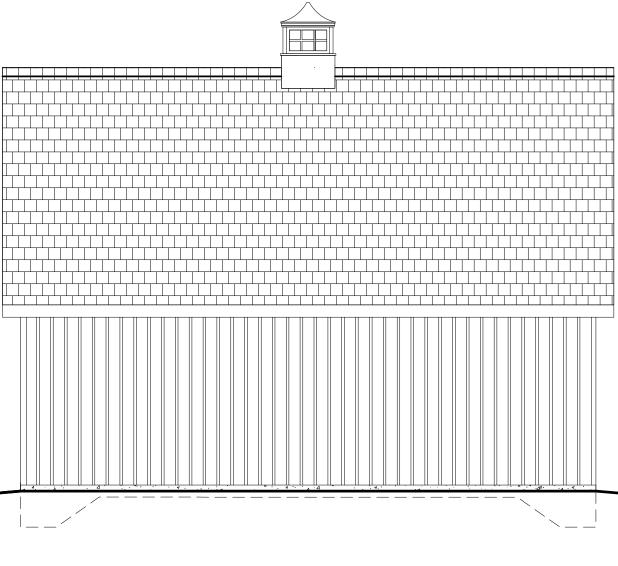

REAR ELEVATION

DRAWING TITLE

SHEET NO.

FLOOR PLAN

SEAL

PROJECT NO.

DRAWN BY

FILE INFO.

REVISIONS

FILE INFO.

**EXTERIOR ELEVATIONS** 

